



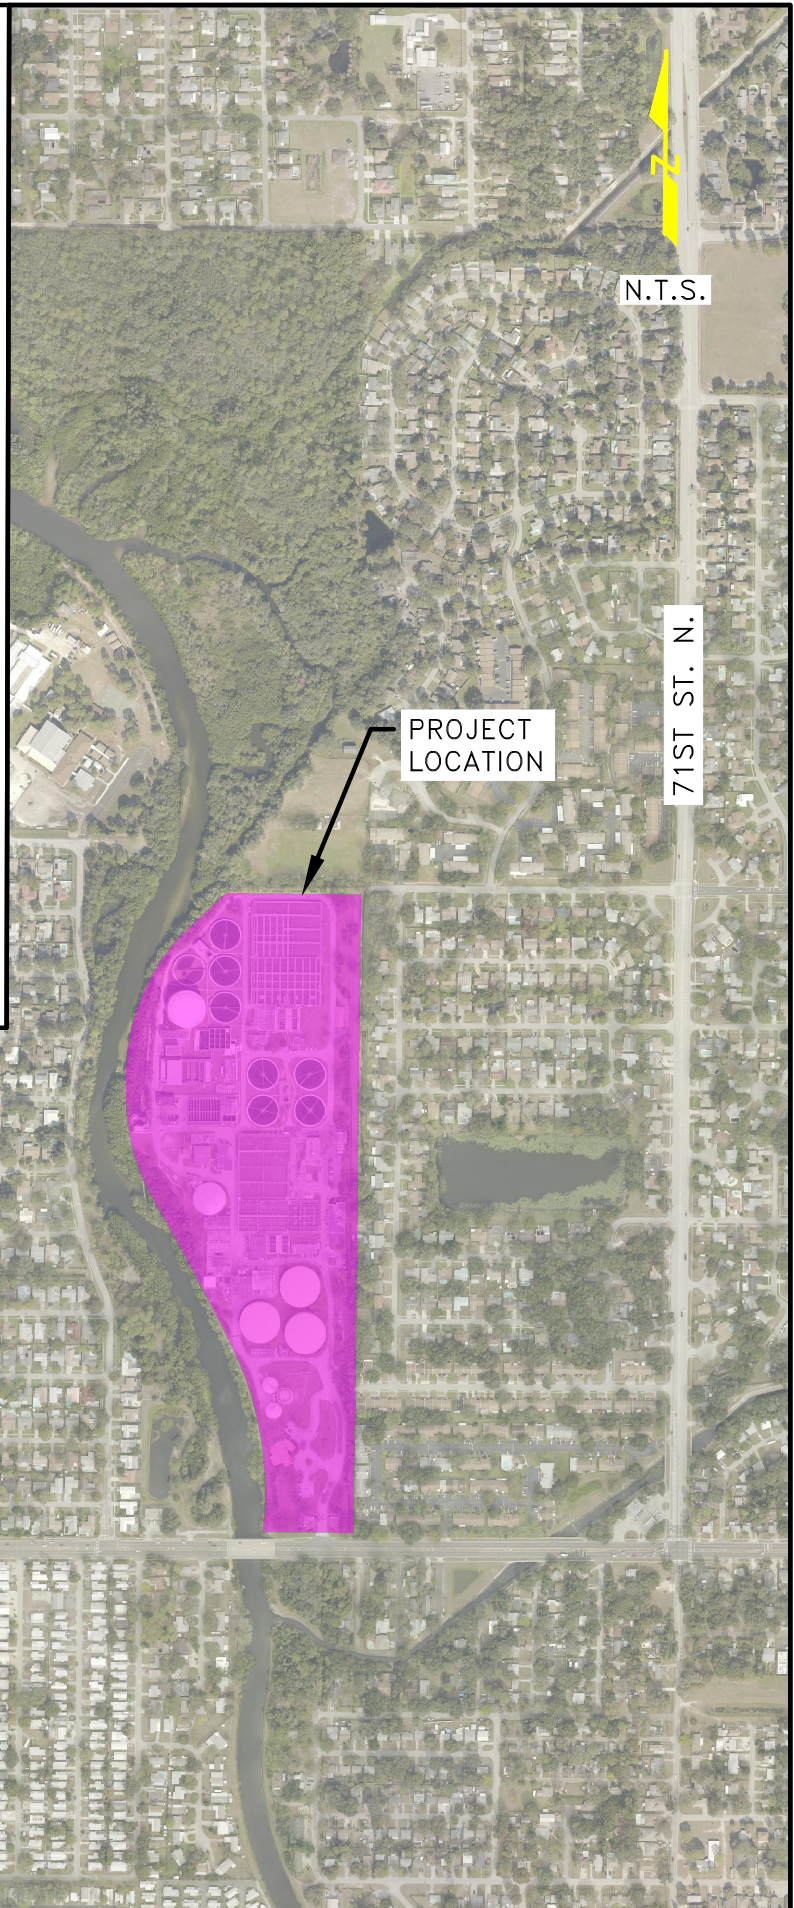

BIOSOLIDS VALVE AND PIPING MODIFICATIONS AT SOUTH CROSS BAYOU WASTEWATER RECLAMATION FACILITY

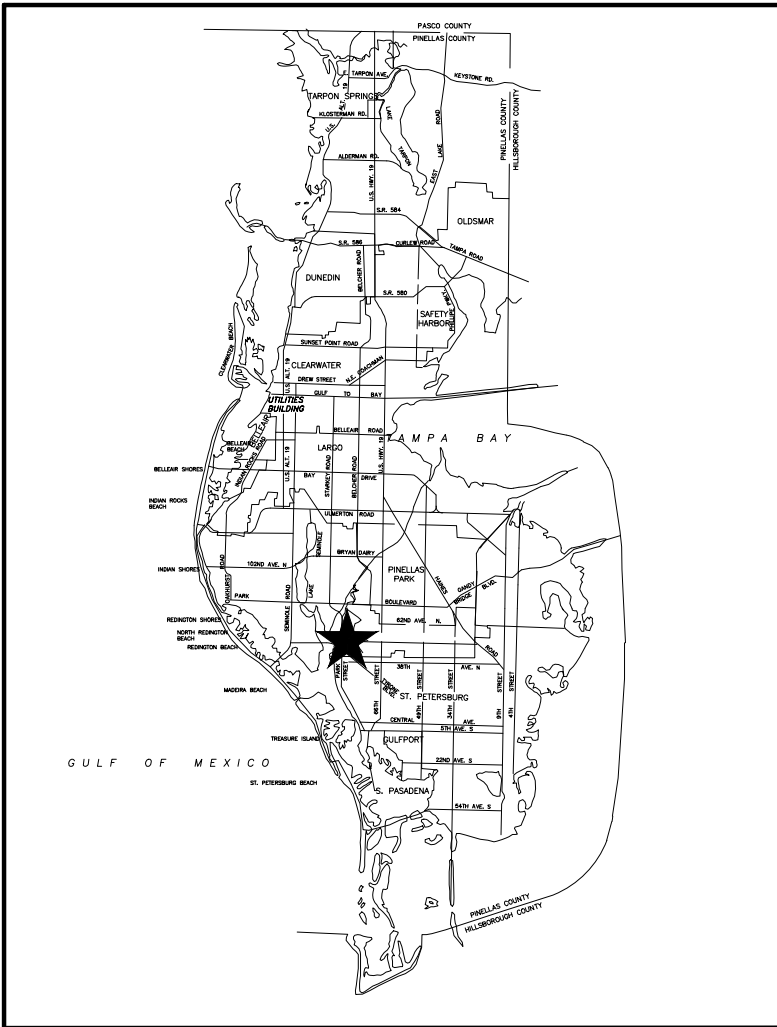